


NOTES:

1. TRACER WIRE SHALL BE TAPE AT 10-FOOT INTERVALS TO THE TOP OF ALL MAINS AND ON WATER SERVICE LINES UP TO WATER METER TILE.
2. VALVE BOX EARS SHALL BE PLACED IN LINE WITH THE TWO PIPES IT SERVES.
3. SET VALVE BOX TO GRADE IN UNPAVED AND PAVED AREAS. IN PAVED AREAS INSTALL CONCRETE COLLAR PER DWG. W-4.
4. VALVE OPERATING NUT EXTENSIONS ARE REQUIRED WHEN THE VALVE NUT IS MORE THAN TWO (2) FEET BELOW FINISHED GRADE. EXTENSIONS ARE TO BE A MINIMUM OF ONE (1) FOOT LONG, ONLY ONE EXTENSION TO BE ALLOWED PER VALVE.
5. ALL VALVE OPERATING NUT EXTENSIONS ARE TO BE MADE OF STEEL, SIZED AS NOTED, AND PAINTED WITH TWO COATS OF METAL PAINT.
6. VALVE BOXES IN PAVED AREAS SHALL BE TWO-PIECE, ADJUSTABLE, CAST IRON WITH EXTENSION PIECES (IF NECESSARY), AS MANUFACTURED BY OLYMPIC FOUNDRY #940, OR TOWN APPROVED EQUAL. THE WORD "WATER" SHALL BE CAST IN RELIEF IN THE TOP.
7. ALL CONSTRUCTION AND MATERIALS SHALL MEET THE SPECIFICATIONS AND BE APPROVED BY THE TOWN.
8. ALL MJ FITTINGS IN WATER SYSTEM REQUIRE EITHER A ROMAC INDUSTRIES GRIP RING ACCESSORY PACK OR TUF GRIP TLD FOR DUCTILE PIPE OR TLP FOR PVC PIPE.
9. 4 INCH MINIMUM SEPARATION FROM THE TOP OF THE MAIN VALVE TO THE BOTTOM OF THE VALVE BOX IS REQUIRED. THE VALVE BOX SHALL NOT REST ON THE VALVE.



NO SCALE

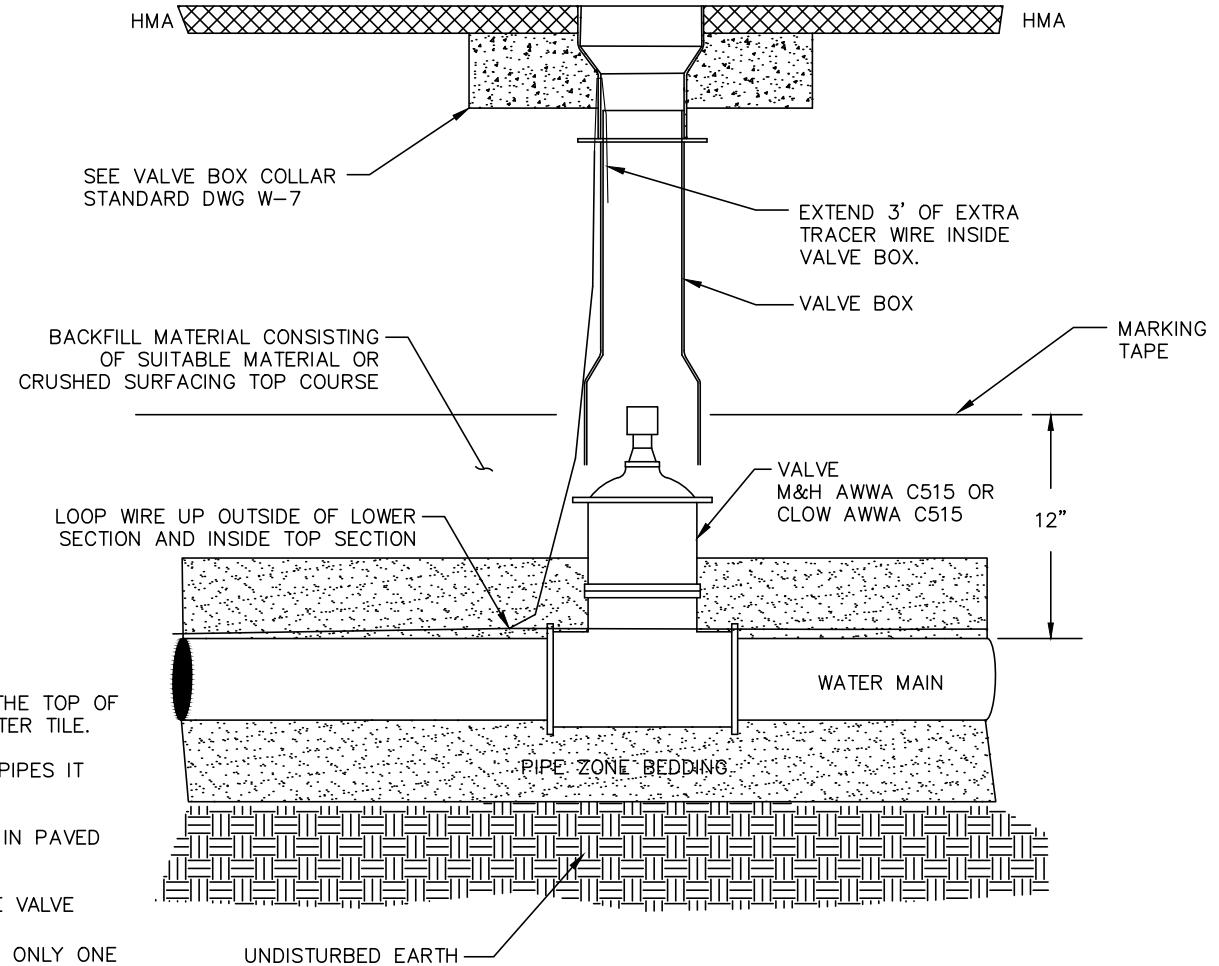

APPROVAL

PUBLIC WORKS DIRECTOR

DATE  
01/21/2022

DRAWING NO.

W-3

REV:

VALVE INSTALLATION