



**FIRE HYDRANT CONCRETE PAD**  
(SEE NOTES 1 AND 2)

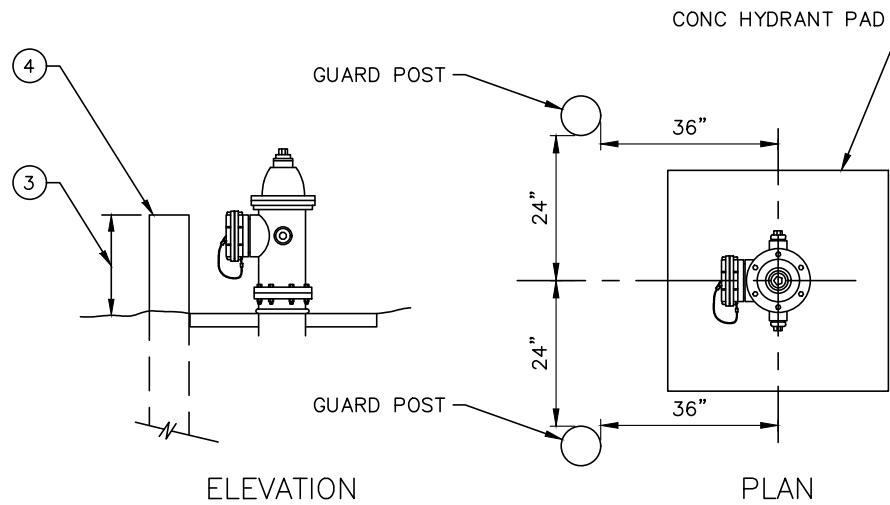

**FIRE HYDRANT GUARD POSTS**  
(SEE NOTES 3 AND 4)

**NOTES:**

1. CONCRETE SHALL BE CLASS 3000.
2. INSTALL 1/2"x4" EXPANSION STRIP AROUND HYDRANT.
3. GUARD POSTS SHALL BE 6' LONG 9" IN DIAMETER PRECAST CONCRETE OR 6' LONG, 6" DIAM SCH 40, CONCRETE FILLED CLASS 52 STEEL PIPE. PAINTED WITH TWO COATS OF KELLY-MOORE LUXLITE Q.D. ALKYD GLOSS ENAMEL #6100-516 CAT YELLOW OR TOWN APPROVED EQUAL.
4. TOP OF GUARD POST SHALL BE LEVEL WITH TOP OF PUMPER PORT.
5. VALVE MARKER POST SHALL BE INSTALLED AT LOCATIONS REQUESTED BY THE TOWN. VALVE MARKER POST SHALL BE 42" PORTABLE TRAFFIC DELINEATOR POST W/TWO REFLECTOR STRIPS. THEY SHALL BE FURNISHED NEW AND UNUSED AND BURIED 24" DEEP, TO LEAVE 18" EXPOSED AS A MARKER POST THE LETTER "V" AND DISTANCE TO THE VALVE SHALL BE STENCILED ON THE POST WITH 2" HIGH NUMERALS, WITH BLACK ENAMEL PAINT.
6. VALVE MARKER POSTS SHALL BE INSTALLED FOR ALL VALVES LOCATED IN UNIMPROVED OR UNPAVED AREAS. VALVE MARKER POST SHALL BE SET AS DIRECTED BY THE TOWN IN A SAFE AND REASONABLY CONSPICUOUS LOCATION.
7. VALVE MARKER POSTS ARE NOT REQUIRED FOR AUXILIARY HYDRANT VALVES.
8. ONE BLUE LANE MARKER, TYPE 2, SHALL BE INSTALLED ON THE ADJACENT PAVEMENT AT A LOCATION DESIGNATED BY THE TOWN.



**VALVE MARKER POST**  
(SEE NOTES 5, 6 AND 7)

NO SCALE

	<b>APPROVAL</b>  PUBLIC WORKS DIRECTOR
	DATE <b>01/21/2022</b>
<b>FIRE HYDRANT CONC. PAD, GUARD POSTS AND VALVE MARKERS</b>	
DRAWING NO. <b>W-6</b>	
REV:	