



- ① SADDLE W/2 IN. FIPT TAP — ROMAC 202S
- ② CORP STOP
- ③ 2" DIA. BRASS IPT NIPPLE (LENGTH AS REQUIRED)
- ④ 2" BRASS 90° IPT ELBOW
- ⑤ 2" AWWA NON-RISING STEM, RESILIENT WEDGE GATE VALVE W/FIPT ENDS AND 2" OPERATING NUT
- ⑥ VALVE BOX — TYLER SERIES 6855 W/DROP LID OR APPROVED EQUAL THE WORD "WATER" TO BE CAST IN LID
- ⑦ 2" COPPER PACK JOINT COUPLING PACK X MIPT FORD C84-77 OR APPROVED EQUAL
- ⑧ 2" DIA TYPE K RIGID COPER PIPE OR 2" 200 PSI PVC CTS
- ⑨ 2" THK. X 12" X 12" CONCRETE BLOCK
- ⑩ 2" COPPER PACK JOINT COUPLING PACK X FIPT FORD C14-77 OR APPROVED EQUAL
- ⑪ 2" MIPT PLUG W/SQUARE OR HEX WRENCH HEAD, BRASS OR PVC
- ⑫ THRUST BLOCK
- ⑬ WATER MAIN — SIZE VARIES
- ⑭ PIPE CAP — SIZE VARIES
- ⑮ 6 MIL PLASTIC

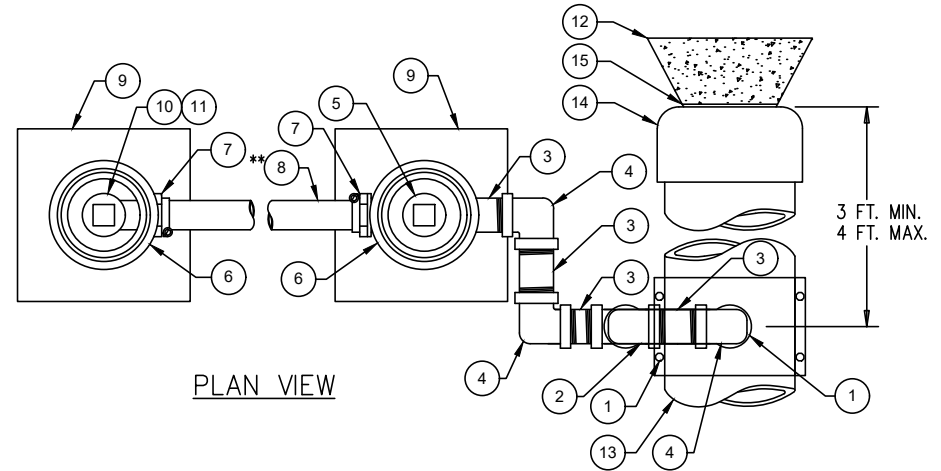

PLAN VIEW

TO BE USED ONLY AS
REQUIRED OR APPROVED BY
THE PUBLIC WORKS DIRECTOR.

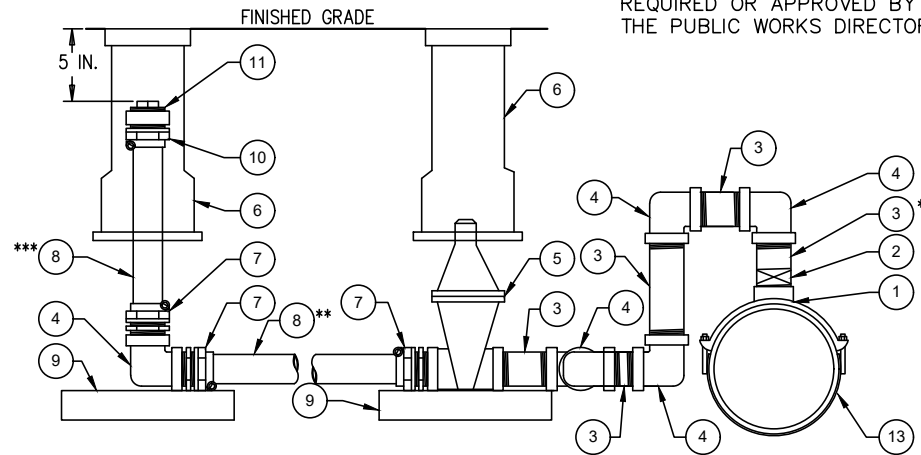



ELEVATION VIEW

NO SCALE

NOTES:

1. SAND OR SELECT BACKFILL REQUIRED WITHIN 6" OF ALL PIPE AND FITTINGS.
- * FOR LIVE TAPS NIPPLE TO BE REPLACED WITH 2" MIPT X MIPT CORPORATION STOP — FORD FB500
- ** COPPER PIPE TO BE CUT AT 24" LONG
- *** COPPER PIPE TO BE CUT AS REQUIRED

	APPROVAL  PUBLIC WORKS DIRECTOR	
	DATE 01/21/2022	
2" BLOW-OFF ASSEMBLY		DRAWING NO. W-14
		REV: