


CONNECTION TO MAIN
NTS

FOR LOCATION OF FIRE DEPARTMENT CONNECTION (FDC) AND POST INDICATOR VALVE (PIV), IF APPLICABLE.



NO SCALE

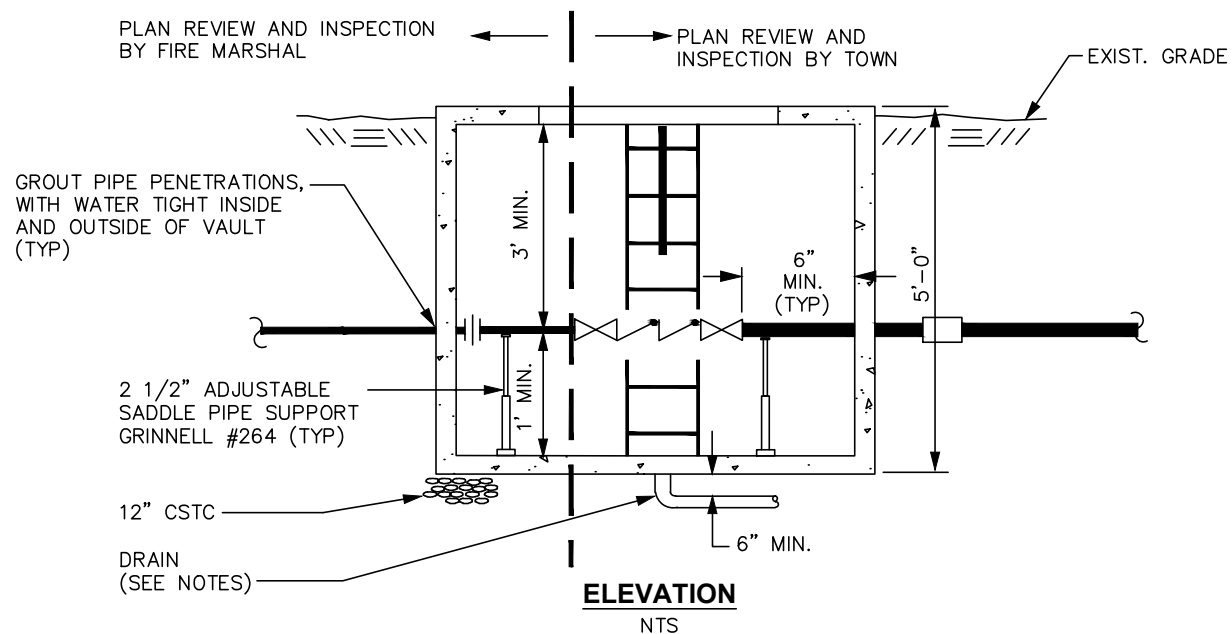

APPROVAL

Wayne R. Hauske

PUBLIC WORKS DIRECTOR

**2 1/2" DOUBLE CHECK
DETECTOR ASSEMBLY**

DATE
01/21/2022

DRAWING NO.
W-17B

REV: