



CEMENT CONCRETE TRAFFIC CURB AND GUTTER



CEMENT CONCRETE TRAFFIC CURB

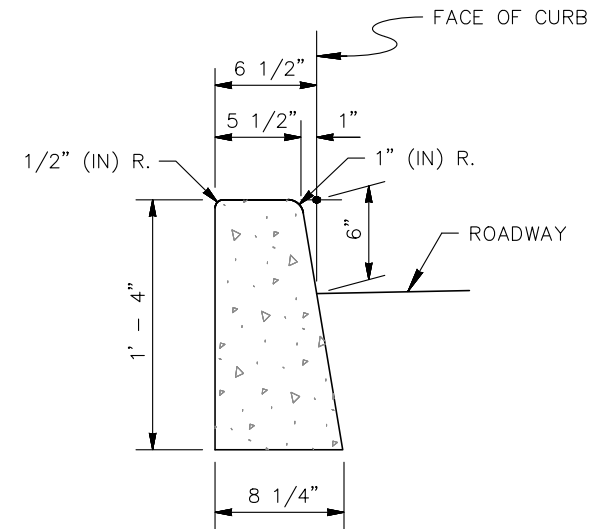

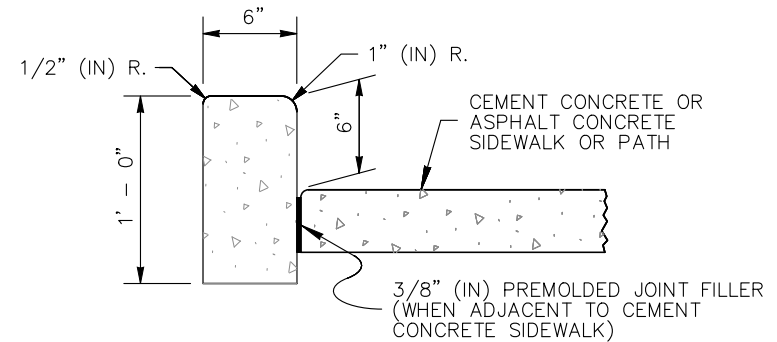

CEMENT CONCRETE PEDESTRIAN CURB

NOTES:

1. THE CURBS, GUTTERS AND SIDEWALKS SHALL HAVE CONTRACTION JOINTS (3/8" x 1-1/2") AT INTERVALS OF NOT GREATER THAN 15'-0".
2. CEMENT CONCRETE SHALL BE CLASS 4000.
3. SEE DRAWING NO. 18 FOR EXPANSION JOINT DETAIL AND SPACING.
4. CURBS SHALL BE CONSTRUCTED ON 4" MIN CRUSHED SURFACING TOP COURSE, COMPACTED TO 95% OF MAXIMUM DRY DENSITY.

NO SCALE

	APPROVAL  PUBLIC WORKS DIRECTOR
	DATE <b>01/21/2022</b>
<b>CEMENT CONCRETE CURBS</b>	DRAWING NO. <b>ST-17</b>
REV:	