




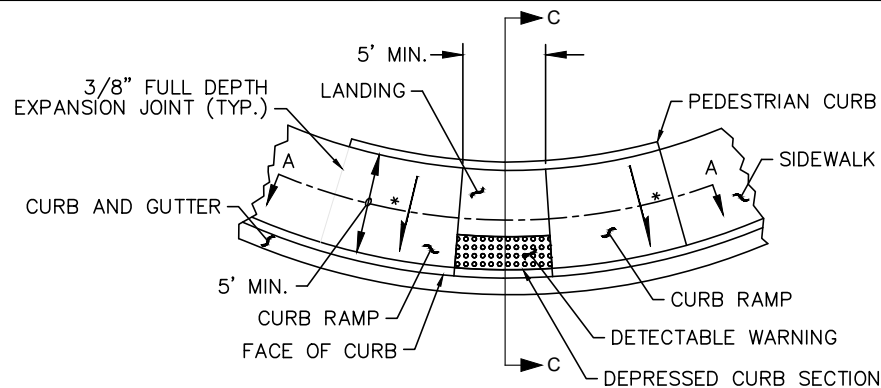


CURB RAMP TYPE PARALLEL A

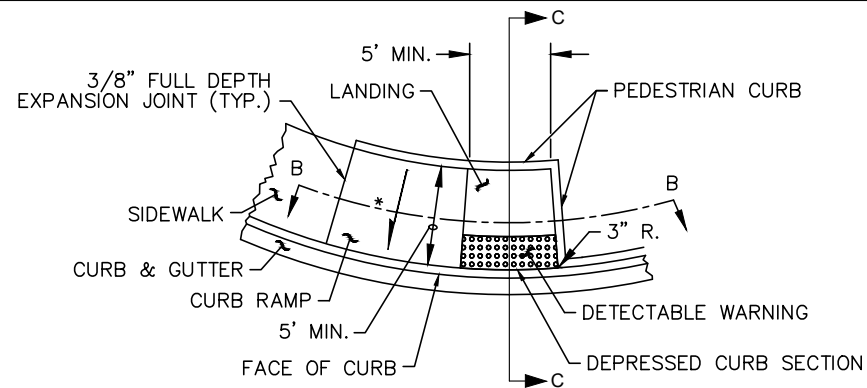


CURB RAMP TYPE PARALLEL B

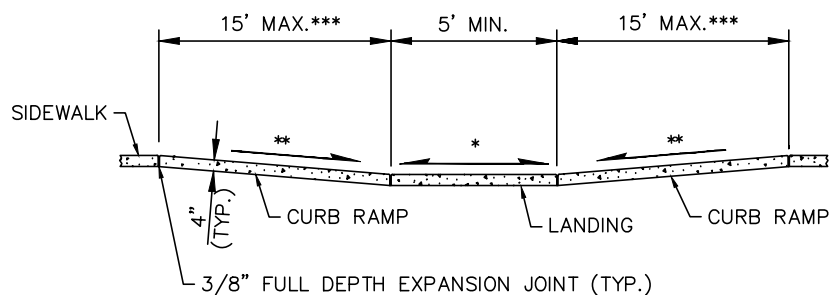

SECTION A-A

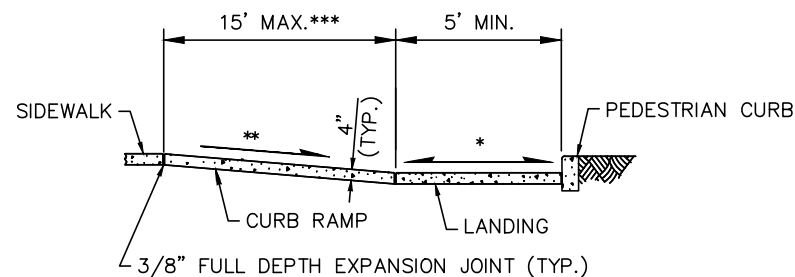

SECTION B-B

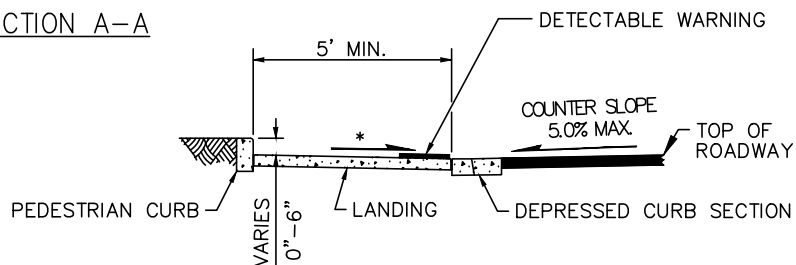

SECTION C-C

NOTES:

SEE ST-20 FOR CURB RAMP CONSTRUCTION NOTES.

LEGEND:

SLOPE IN EITHER DIRECTION

* 1.5% OR FLATTER RECOMMENDED FOR DESIGN/FORMWORK (2% MAX).

** 7.5% OR FLATTER RECOMMEND FOR DESIGN/FORMWORK (8.3% MAX).

*** RUNNING SLOPE OF THE CURB RAMP SHALL BE 8.3% MAXIMUM BUT SHALL NOT REQUIRE THE RAMP LENGTH TO EXCEED 15 FT. AS MEASURED RADIALLY AT BACK OF RAMP.

NO SCALE



APPROVAL

Wayne R. Hauske

PUBLIC WORKS DIRECTOR

**PARALLEL
CEMENT CONCRETE
CURB RAMP**

DATE
01/21/2022

DRAWING NO.
ST-22

REV: